


For further information on running the flue refer to **Sec. C7** of the **Escea DF Series Installation Manual** which can be downloaded from our website - www.escea.com/nz/technical/

note:

- It is advisable to secure the flexible flue to prevent movement, vibration and sagging - this will also assist in maintaining the required 50mm standoff
- Powerflue electrical cable is to be inserted through silicone grommet when being connected to PCB
- Network cable connection is through the silicone grommet into the electronics tray underneath the firebox.
- Refer to **Sec. D5** of the Escea DF Series Install Manual for the correct location of gas supply pipe through silicone grommet and into regulator

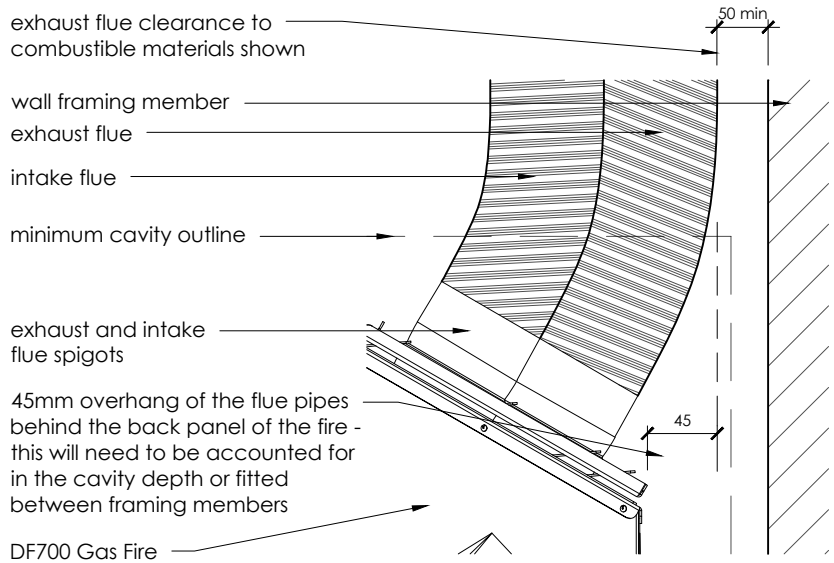

Flue Clearance


scale 1:5

DF Series Fires have a **50mm** exhaust flue clearance, to combustibles materials, for a minimum length directly from the fire chassis.
DF700 - 900mm
DF960 - 600mm
DFS730 - 900mm

IMPORTANT:

This technical sheet must be read in conjunction with Escea's DF Series Installation Manual, the latest version can be found on our website www.escea.com/nz/technical/

Contact the **ESCEA Architectural Advisory Team** for assistance with installation of this fire - aa@escea.com

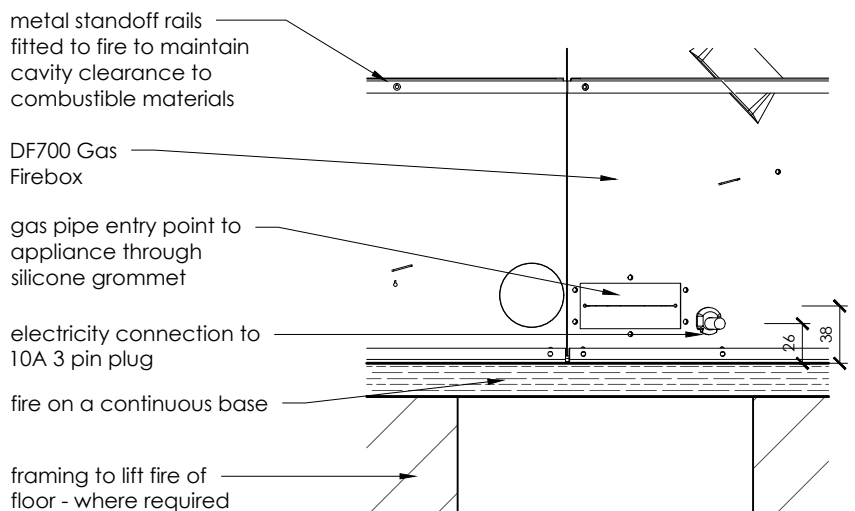

Supply Connection Points

scale 1:5

file: DF SERIES MASTER FILE.dwg	scale: 1:5	ecn: ECN-2690	drawing no: EDA-0055	revision: V. 01	date: 06.10.2017	drawn: MG
------------------------------------	----------------------	-------------------------	--------------------------------	---------------------------	----------------------------	---------------------